

100

SYSTEM: CONTROL MODULE Block, pidloop -Parameters [project]

MainServer HistoryServer Displays

Name:pidloop

Description:

Eng: Units:

Keyword:

Execution Period:DEFAULT

Execution Phase:-1

Unit Text:

Version:102

Enable Alarming Options:☒

Execution Order in CEE:10

SCM Option:NONE

SCM Name:

Fieldbus Specific

Execution Order in CEE:10

Side Count:2

FF Execution Period:15

☐ Show Parameter Names

OKCancelHelp

LEVEL 1

FIG. 1

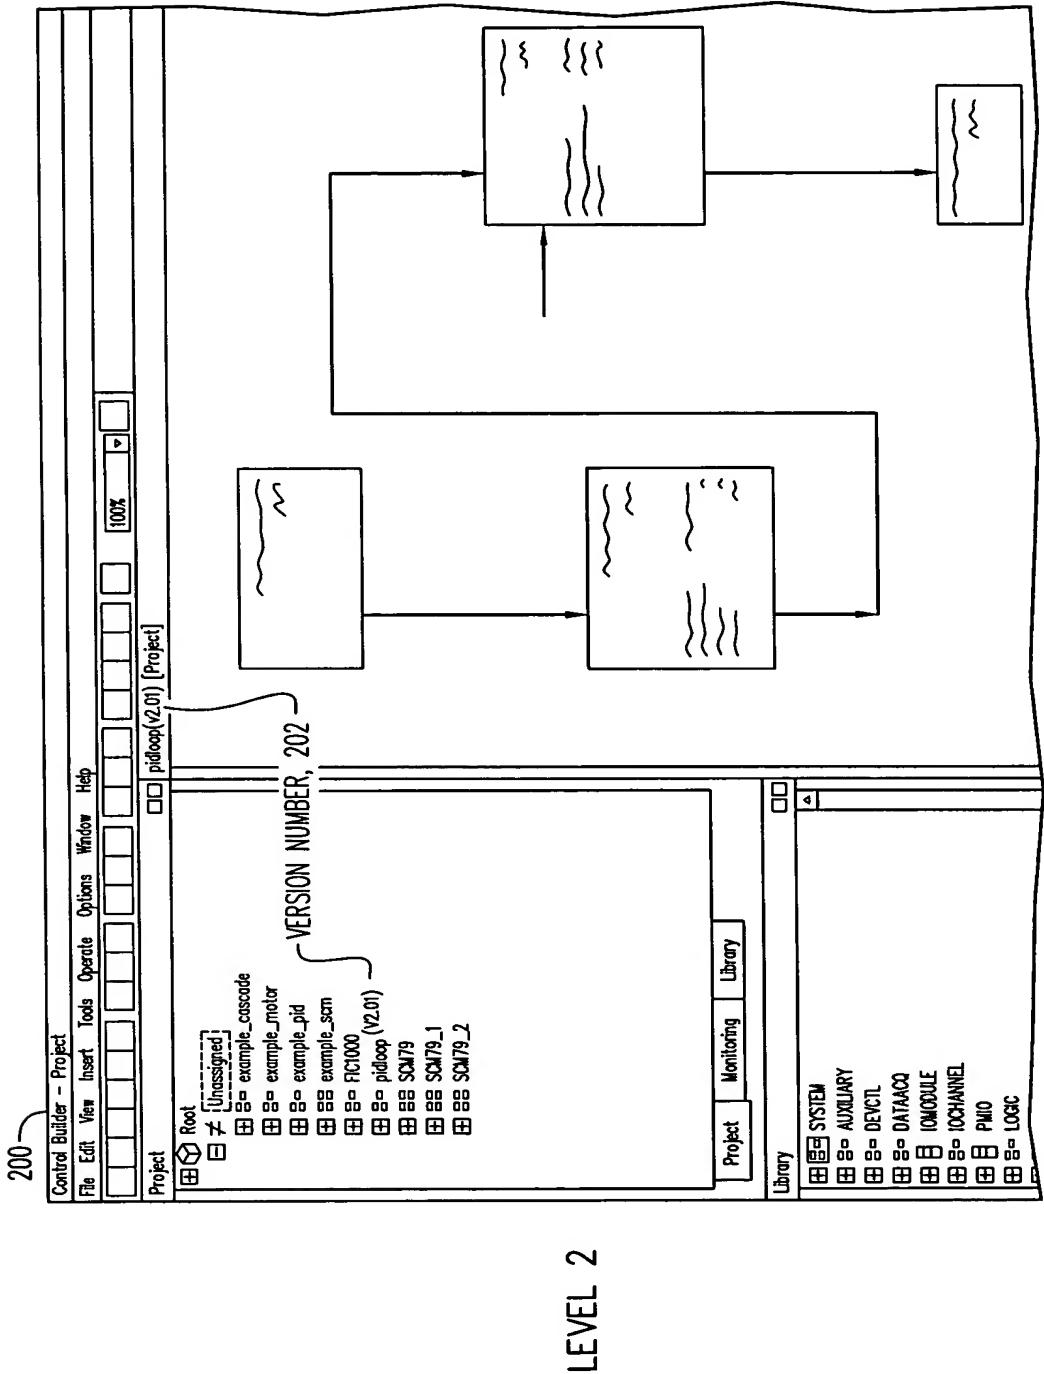


FIG. 2

Version Properties

Name: CM_1_34_INST 300
Version: 3.00 302
Status: Checked-in
Comment: Fixed alarm limit
Created by: Experion PKS User
Created on: 11/7/2003 11:37:53 AM
Last modified by: Experion PKS User
Last modified on: 11/7/2003 11:39:38 AM

Qualification State Configuration

Current state:

Revert Label Configuration

#	Applied revert labels

Apply/Remove Labels...

FIG. 3

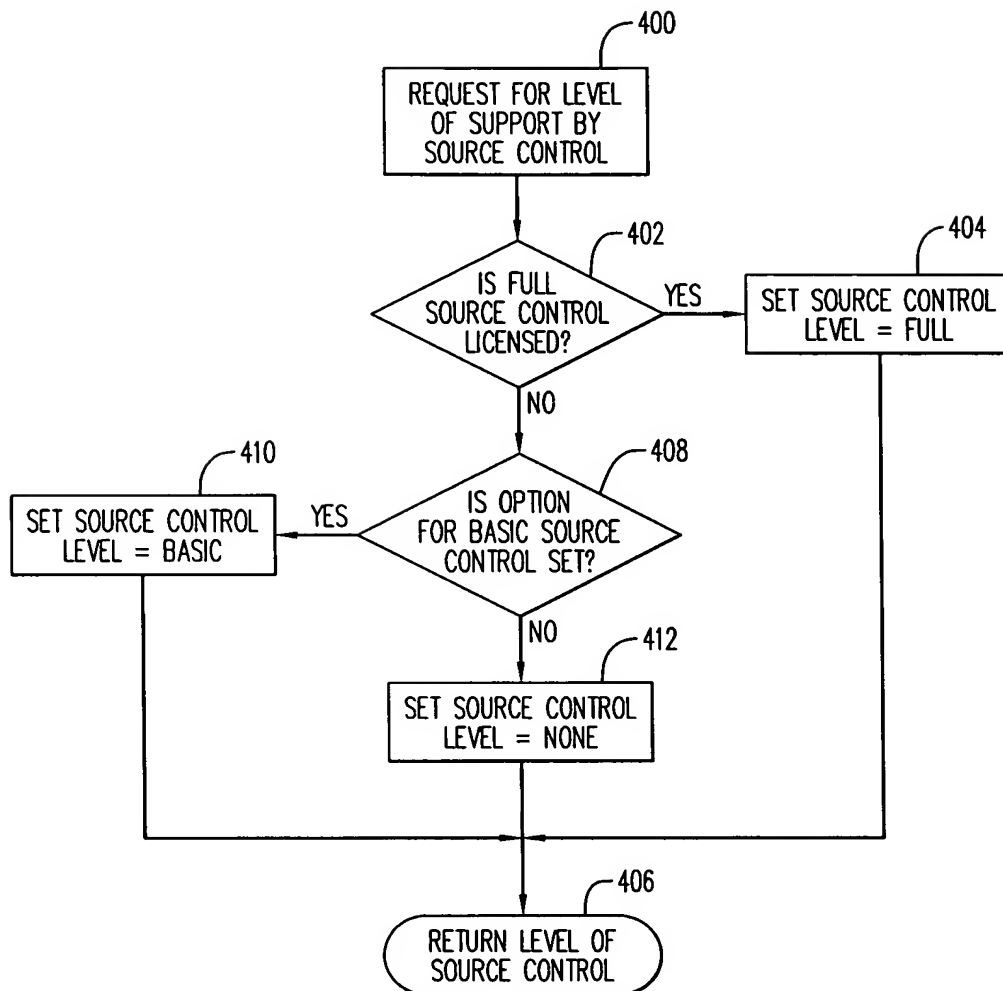


FIG. 4

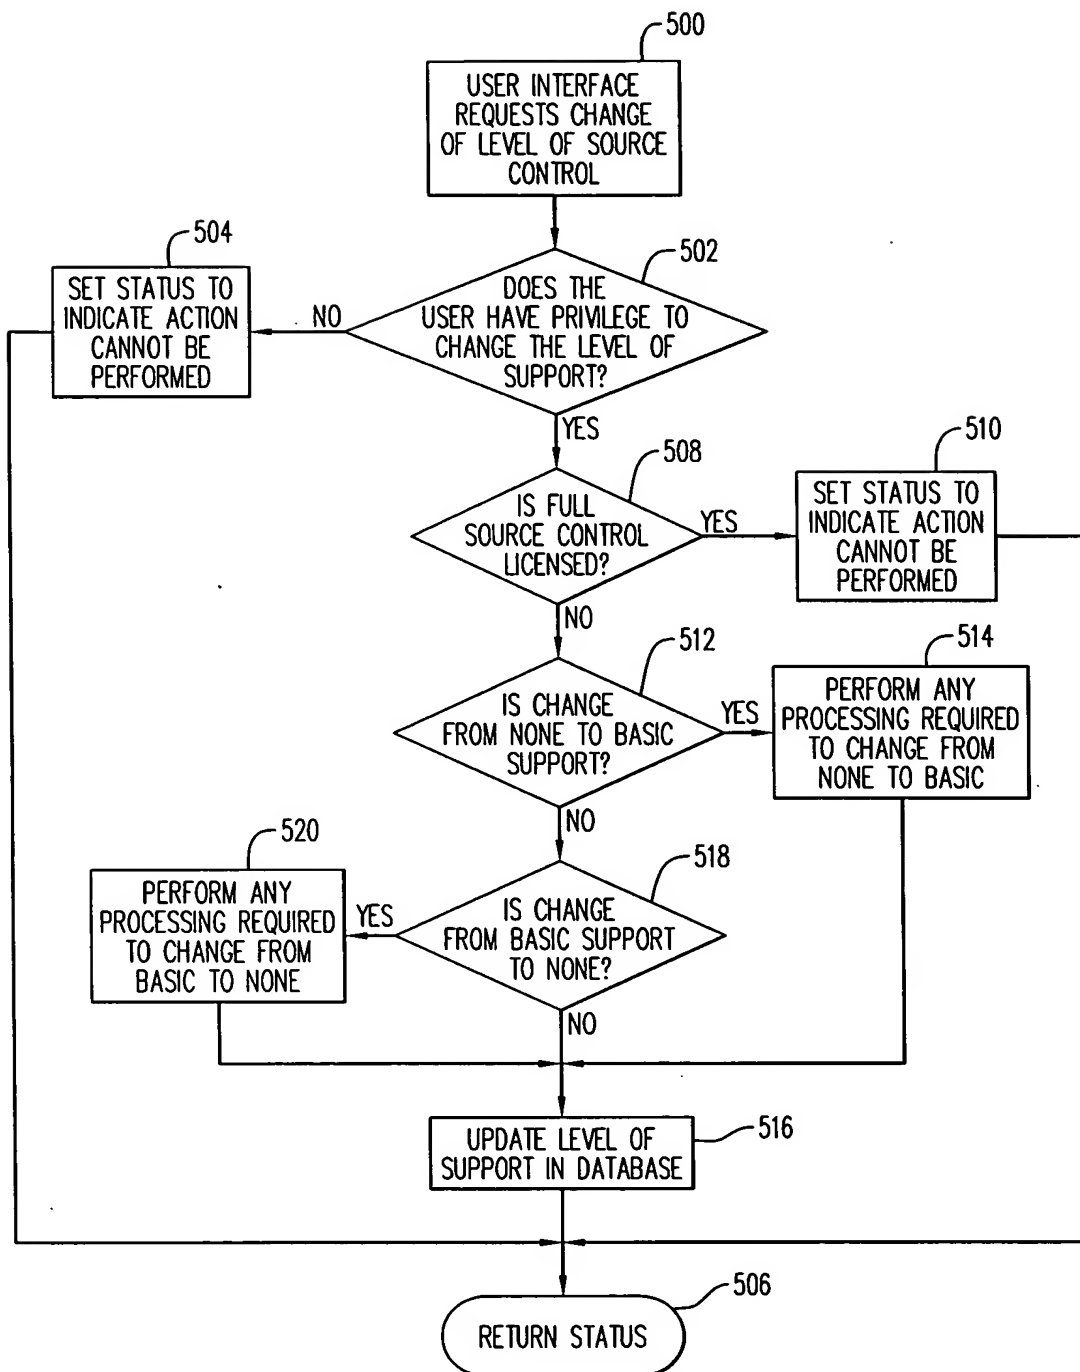
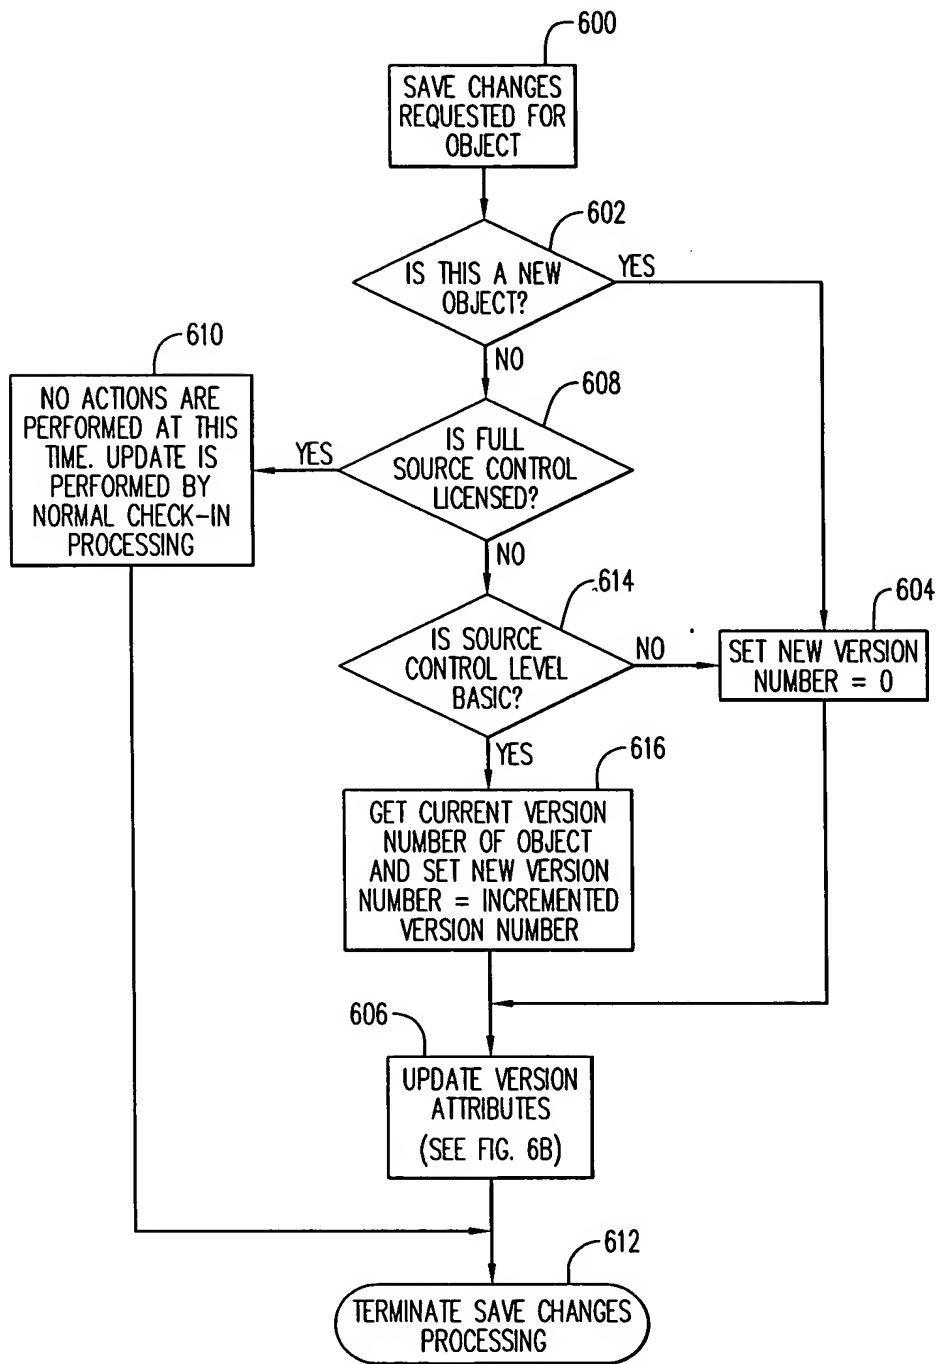


FIG. 5

**FIG. 6A**

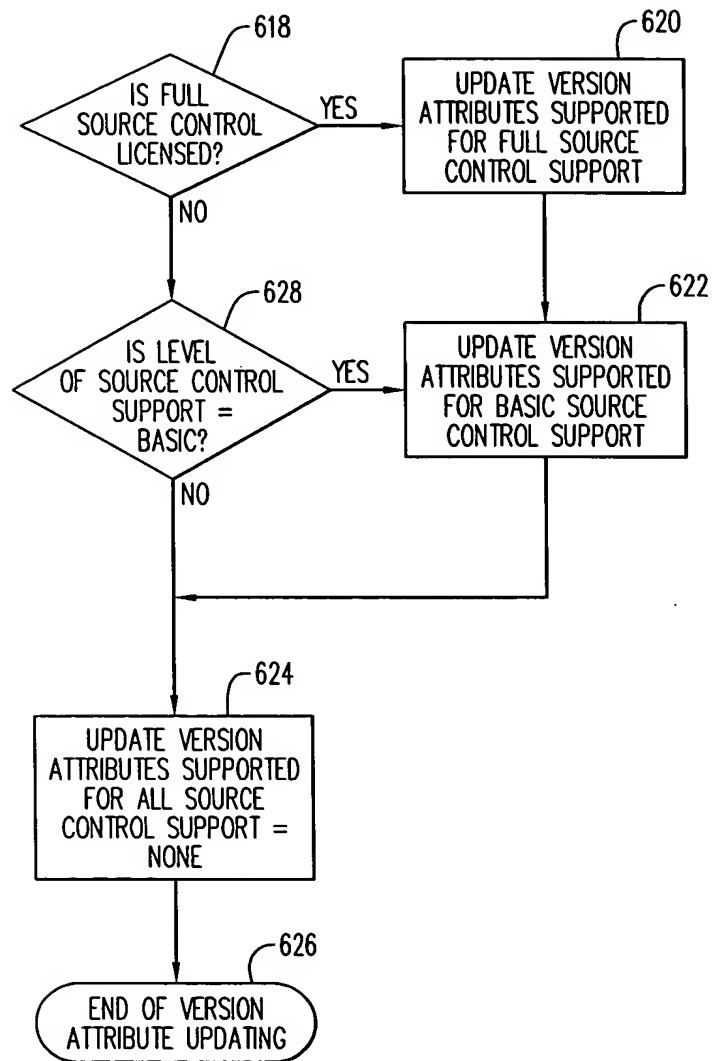


FIG. 6B

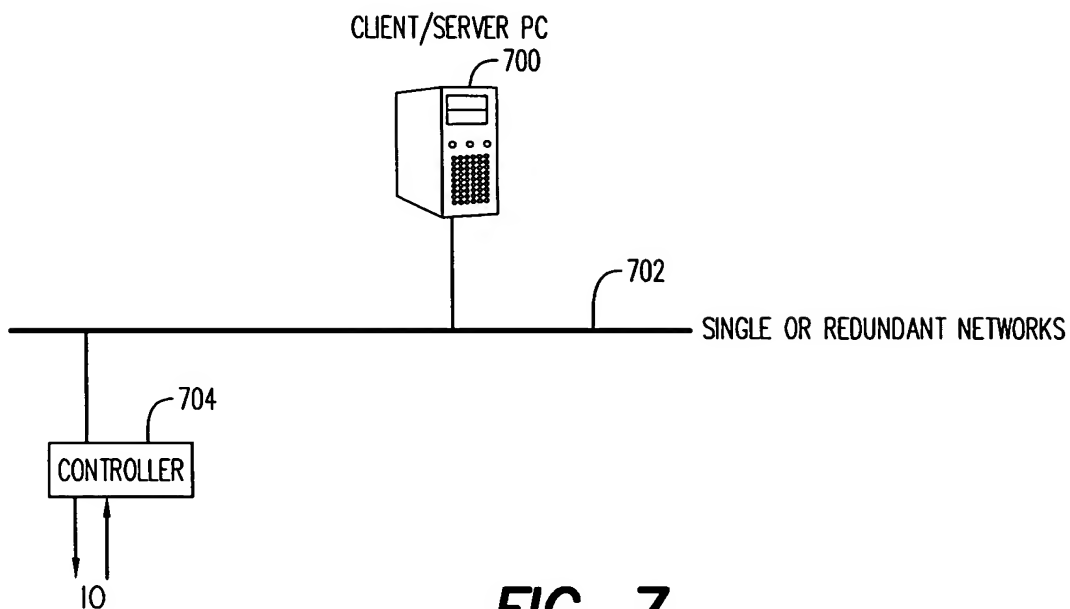


FIG. 7

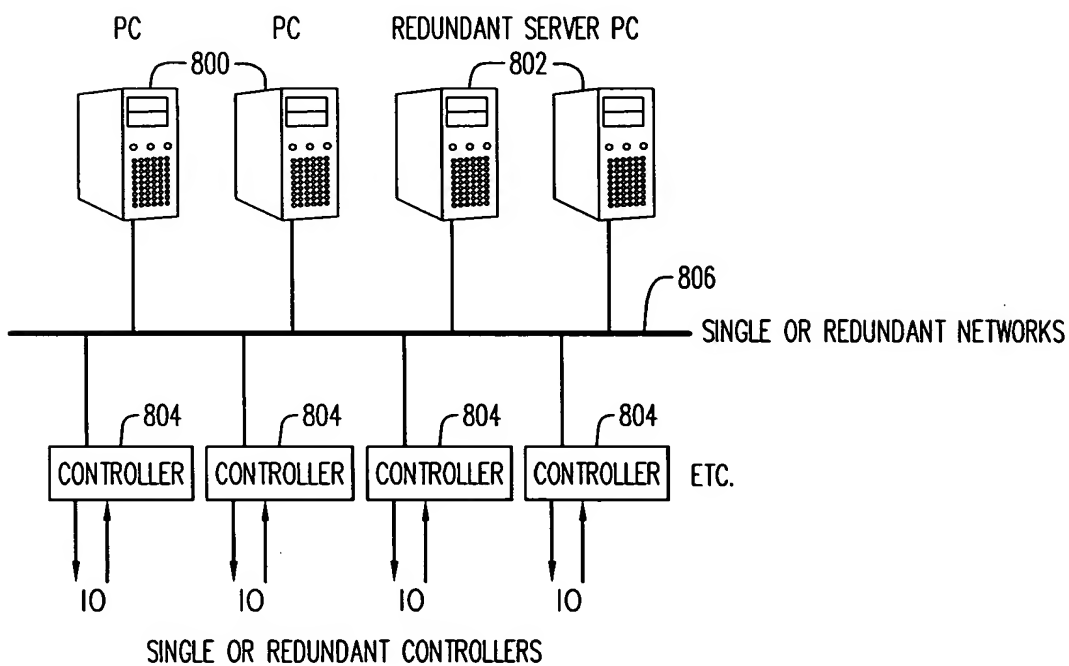


FIG. 8